


Lift call panel with integrated reader
Located within lift car

Cat 5/6* IP Network*

12v DC*

Belden Cable
For card reader*

Cat 5/6*

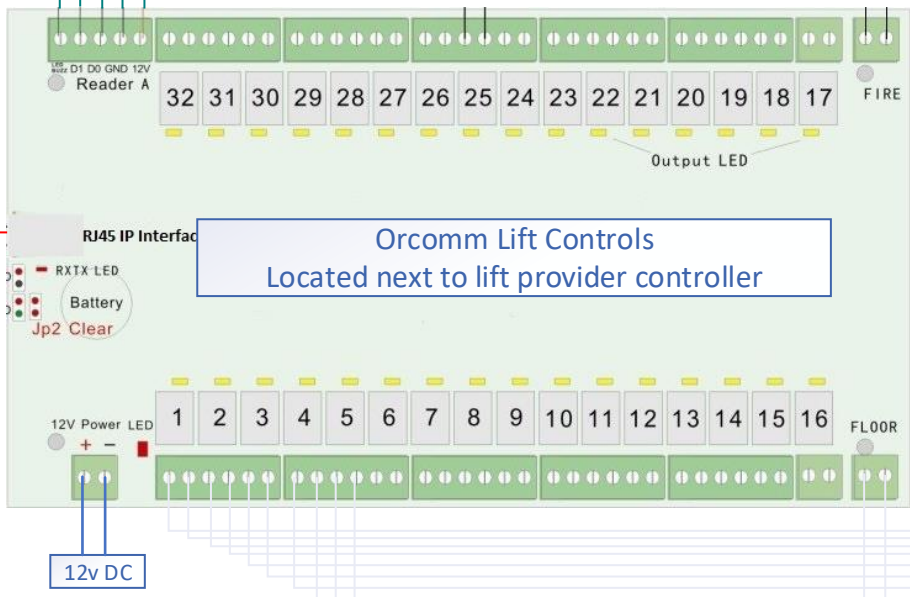

Orcomm Lift Controls
Located next to lift provider controller

12v DC

Connections repeated for each floor
required.

Lift floor selection I/O board*

CDM	Floor 1	Floor 17	CDM
NO			NO
CDM	Floor 2	Floor 18	CDM
NO			NO
CDM	Floor 3	Floor 19	CDM
NO			NO
CDM	Floor 4	Floor 20	CDM
NO			NO
CDM	Floor 5	Floor 21	CDM
NO			NO
CDM	Floor 6	Floor 22	CDM
NO			NO
CDM	Floor 7	Floor 23	CDM
NO			NO
CDM	Floor 8	Floor 24	CDM
NO			NO
CDM	Floor 9	Floor 25	CDM
NO			NO
CDM	Floor 10	Floor 26	CDM
NO			NO
CDM	Floor 11	Floor 27	CDM
NO			NO
CDM	Floor 12	Floor 28	CDM
NO			NO
CDM	Floor 13	Floor 29	CDM
NO			NO
CDM	Floor 14	Floor 30	CDM
NO			NO
CDM	Floor 15	Floor 31	CDM
NO			NO
CDM	Floor 16	Floor 32	CDM
NO			NO
CDM	Ground		CDM
NO			NO

*Provided by others.